
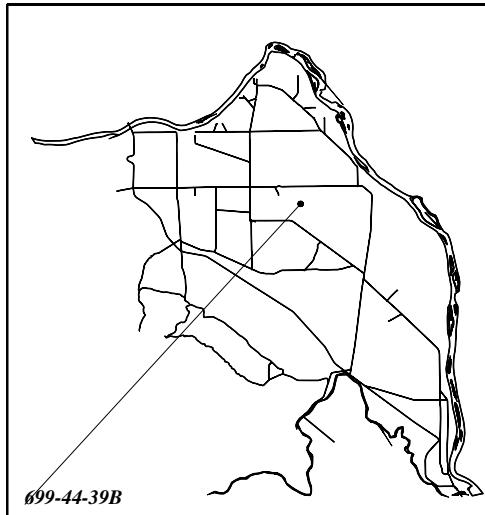




# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-600-699 WELL#=699-44-39B

## RADIONUCLIDES

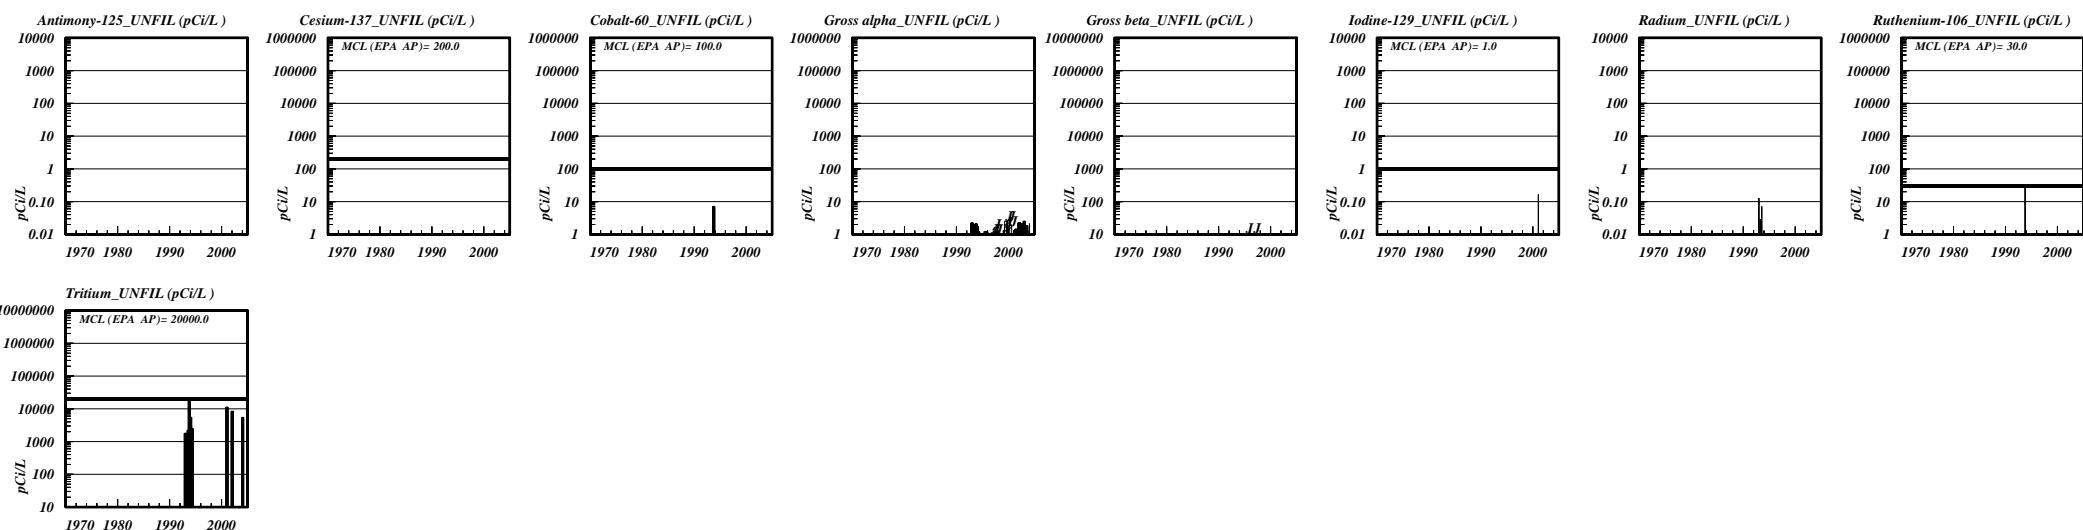

## VOLATILE ORGANIC COMPOUNDS

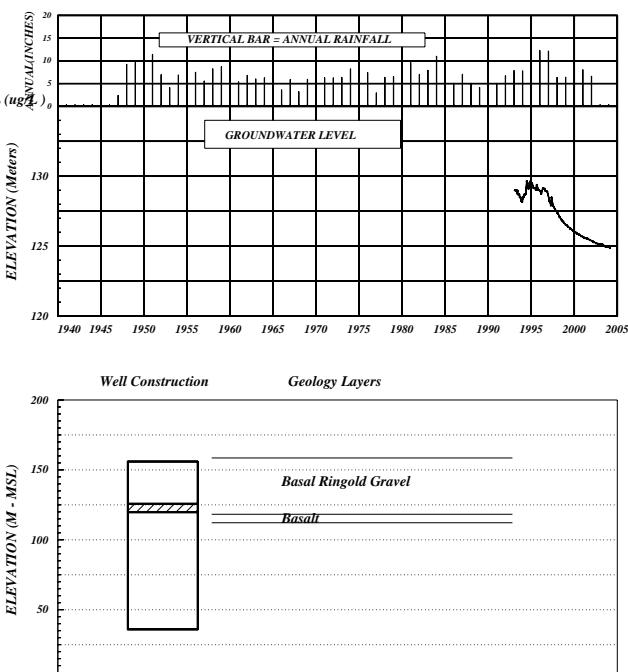
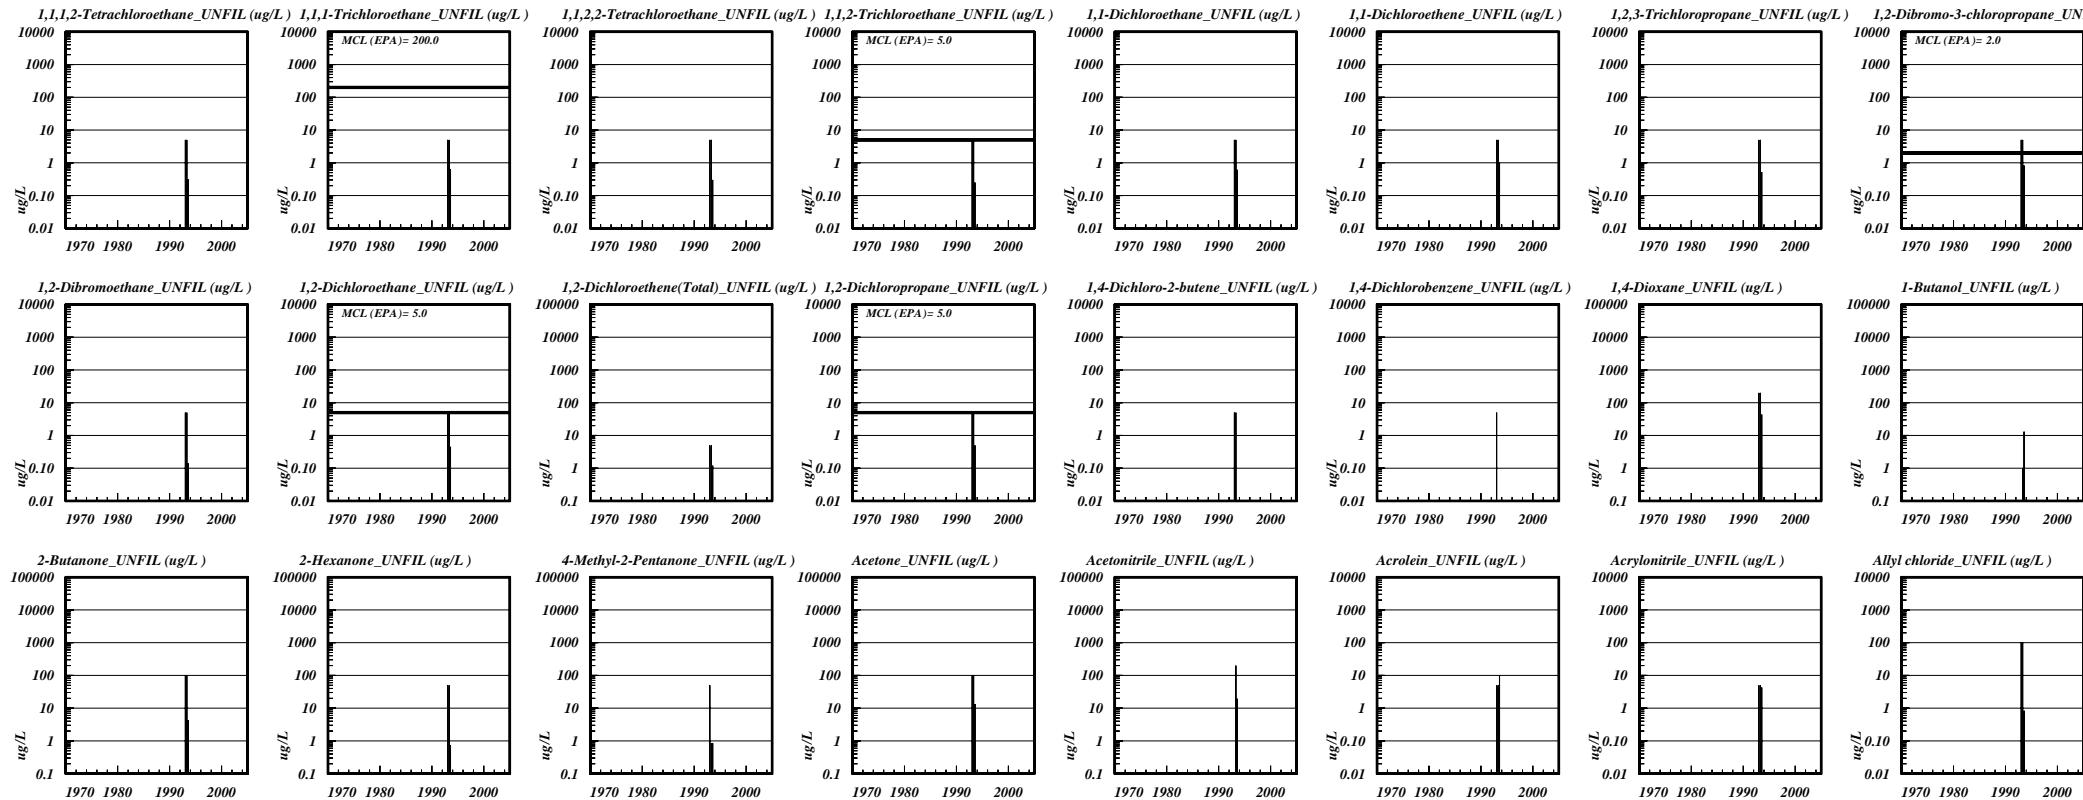


WELLNAME=699-44-39B WELLID=A5185

Well Type=STANDARD Well purpose=GROUNDWATER  
 Owner=DOE Contact=BHI Well Adm Compliance=COMPLIANT  
 $X_{coor}=577960.60$   $Y_{coor}=136727.40$  Datum=NAD83(91) Date Survey= 8/8/1994  
 Elevation= 156.000 Datum=NGVD29 Date Survey=08/08/94  
 Ref\_Point\_Desc=BRASS CAP Ref\_Point\_side=NONE Contractor=USACE(JECA)  
 Total Number of perforation Intervals=1  
 NPERF#=1 Perf\_top= 126.18 Bot= 120.09 MCas\_size= 0.00 Perf\_cuts= 0.00  
 Total Number of Screen Intervals=1  
 Screen#=1 Screen\_diam= 4.00 in Top= 30.16 Bottom= 36.32 m Slot\_size= 0.01 in  
 Screen\_material=Stainless Steel  
 Total Number of Screens=6  
 Seal#=1 Depth\_top=-0.15 Bottom= 0.61 m Material=Concrete  
 Seal#=2 Depth\_top= 0.61 Bottom= 3.11 m Material=Cement Grout  
 Seal#=3 Depth\_top= 3.11 Bottom= 27.04 m Material=Granular Bentonite  
 Seal#=4 Depth\_top= 27.04 Bottom= 28.62 m Material=Hole Plug Bentonite  
 More Information is at <http://www.envirodataaccess.com/wellfiles/699-44-39B.htm>

LABORATORY QUALIFIER FLAGS in HEIS are \*; >; B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;


EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

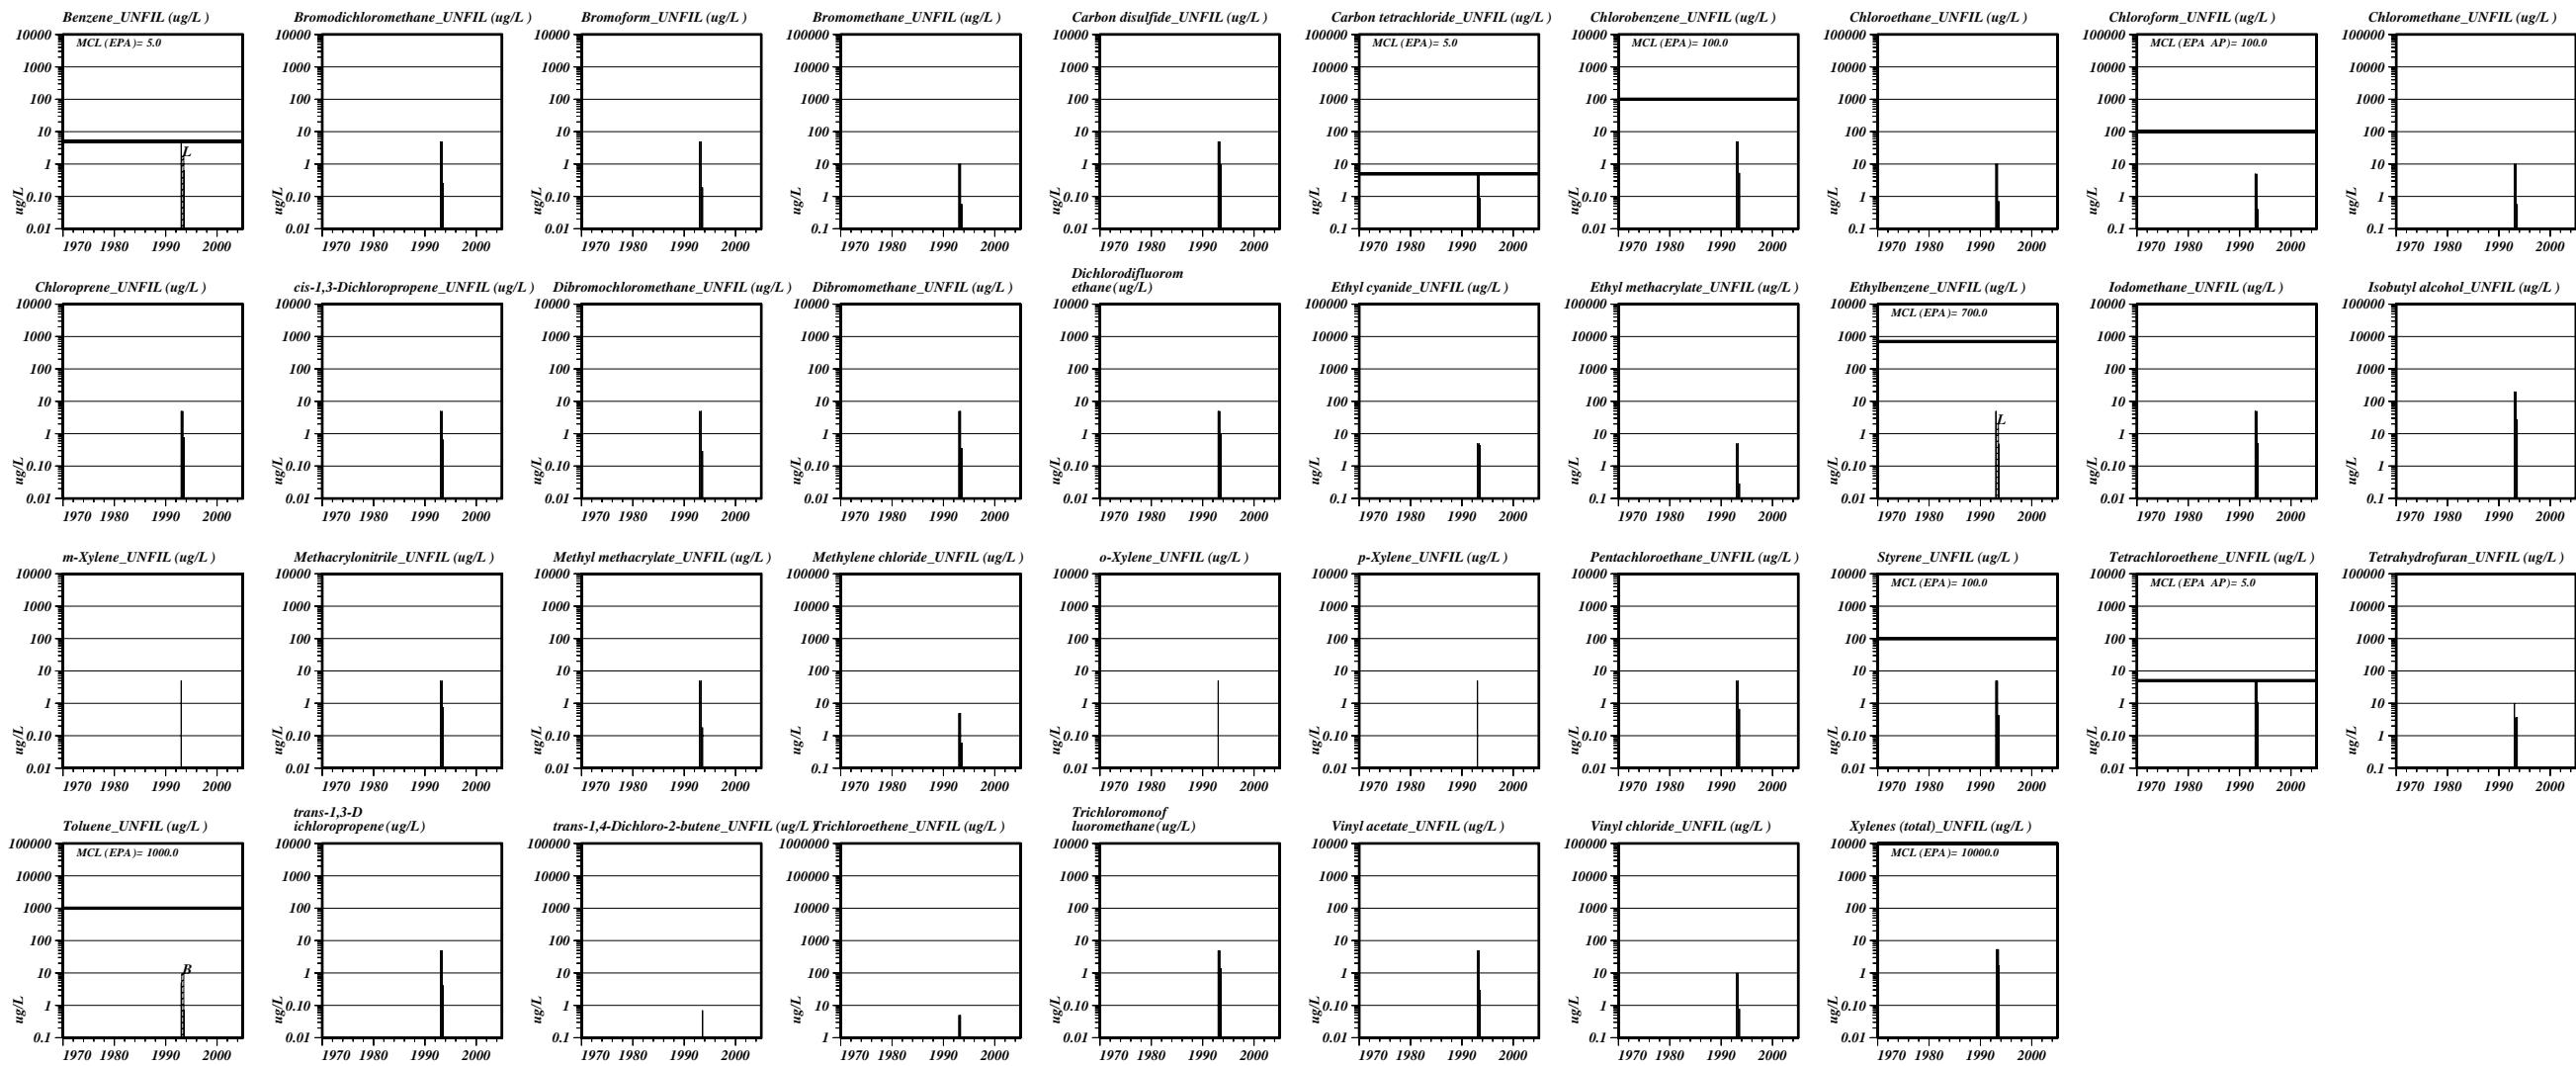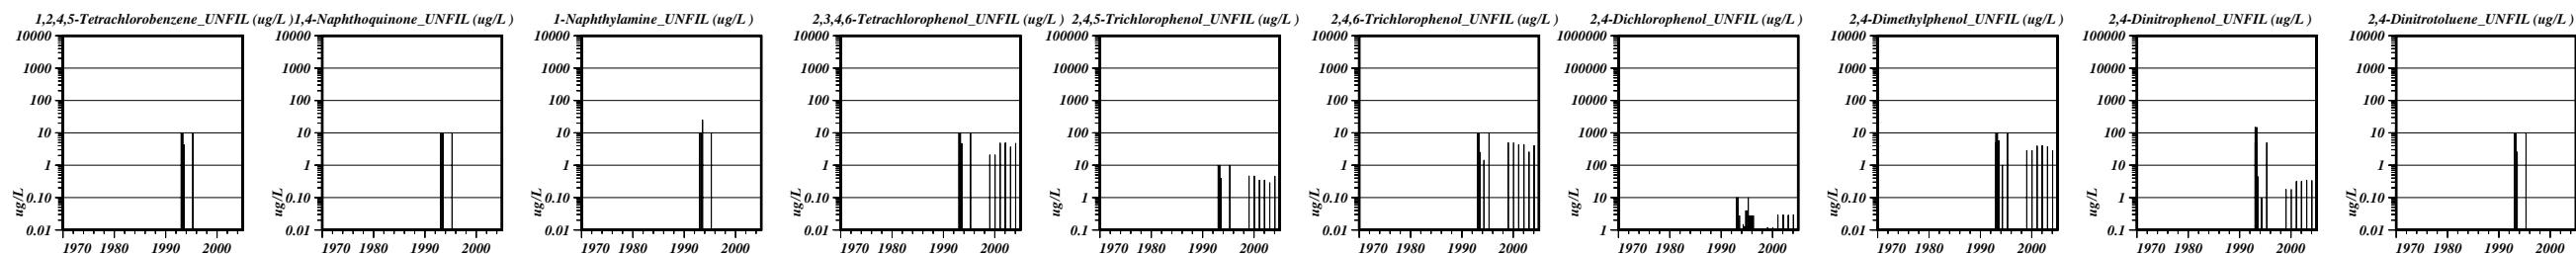**VOLATILE ORGANIC COMPOUNDS****SEMI-VOLATILE ORGANIC COMPOUNDS**

LABORATORY QUALIFIER FLAGS in HEIS are \*; >; B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


## SEMI-VOLATILE ORGANIC COMPOUNDS

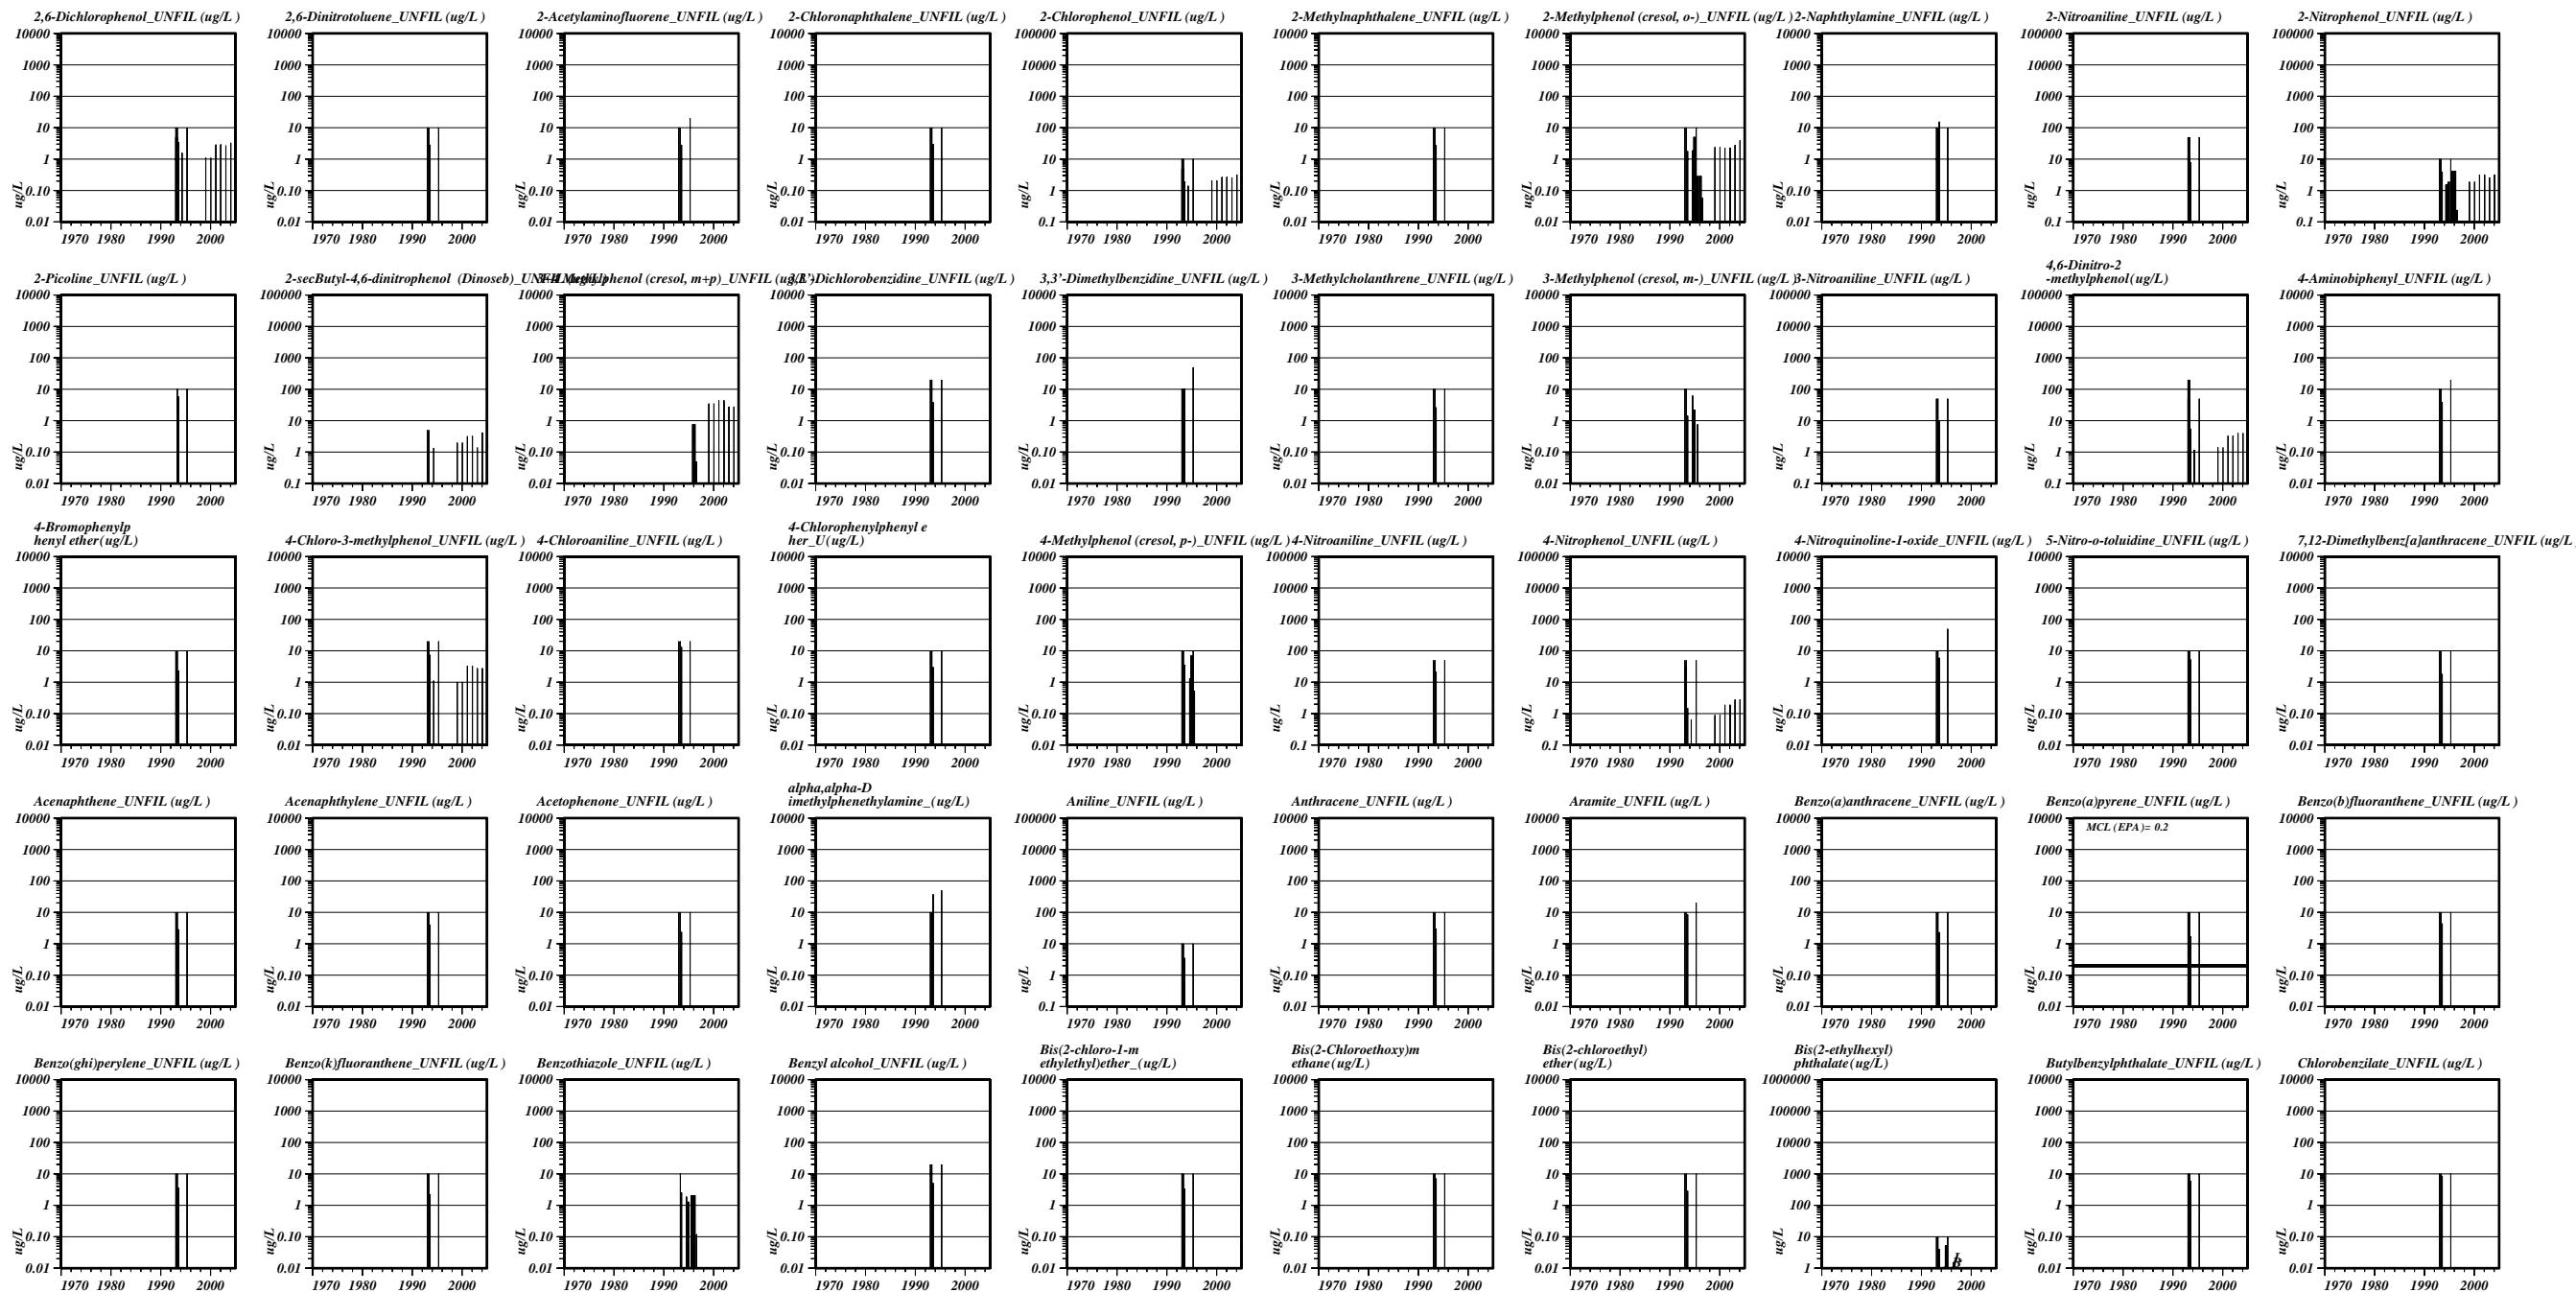

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:



EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

## SEMI-VOLATILE ORGANIC COMPOUNDS

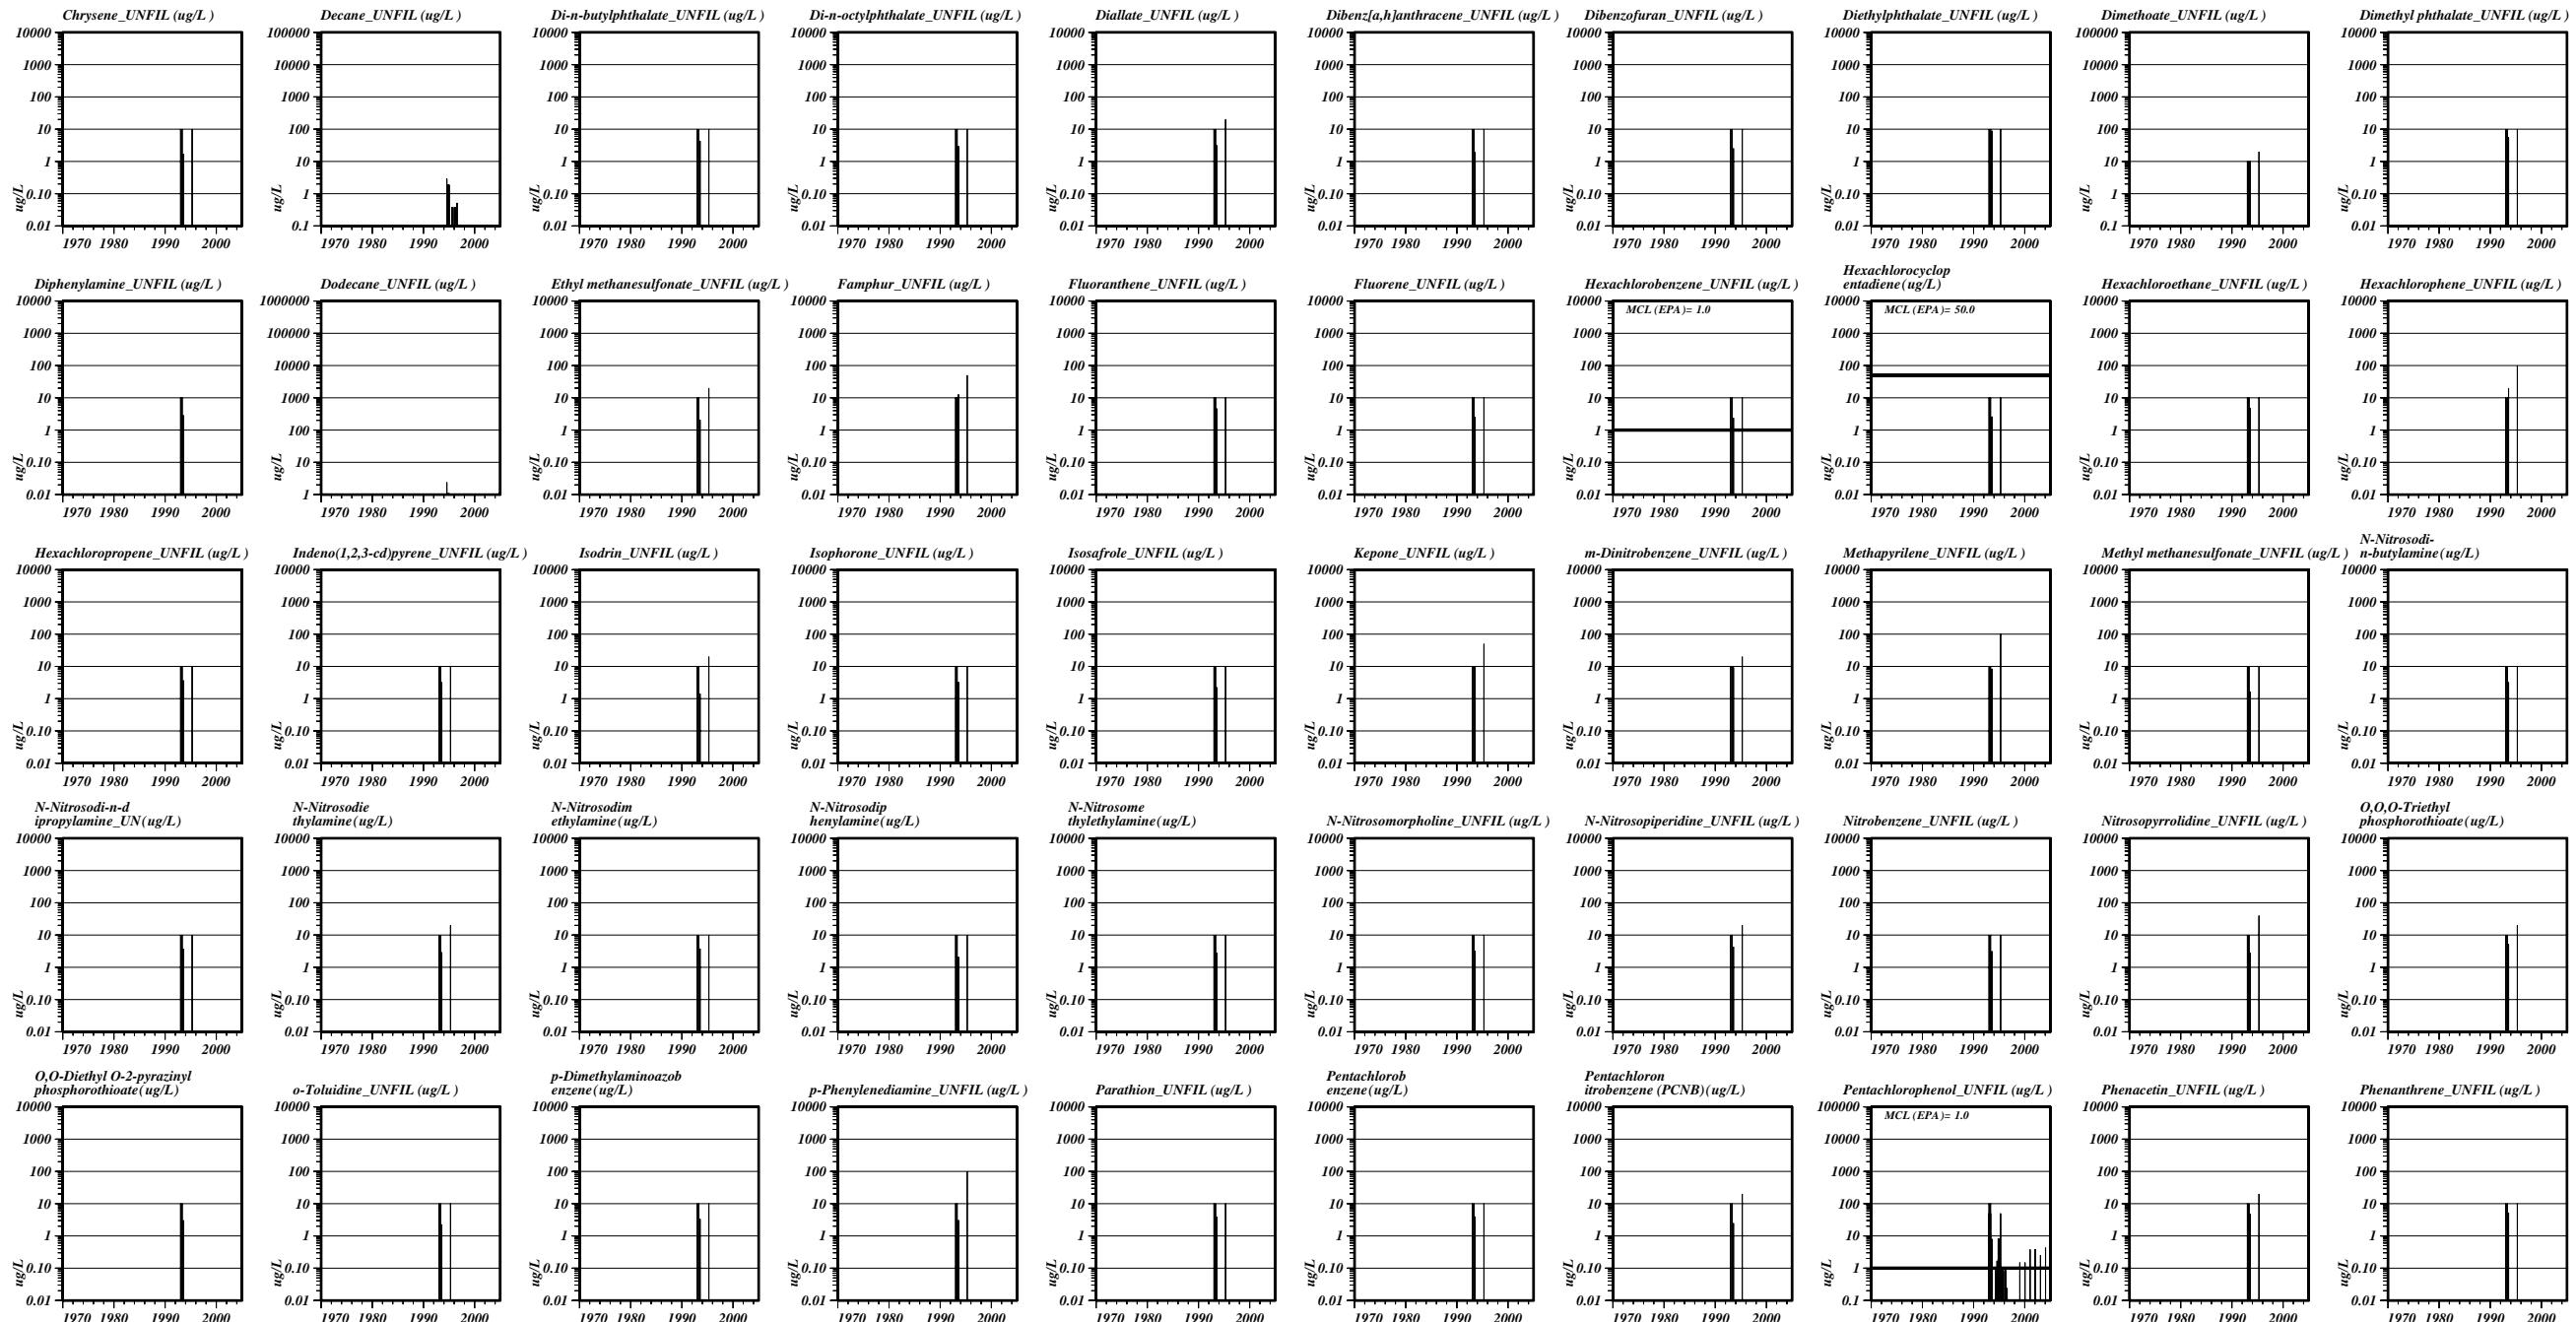

LABORATORY QUALIFIER FLAGS in HEIS are \*; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:


EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag

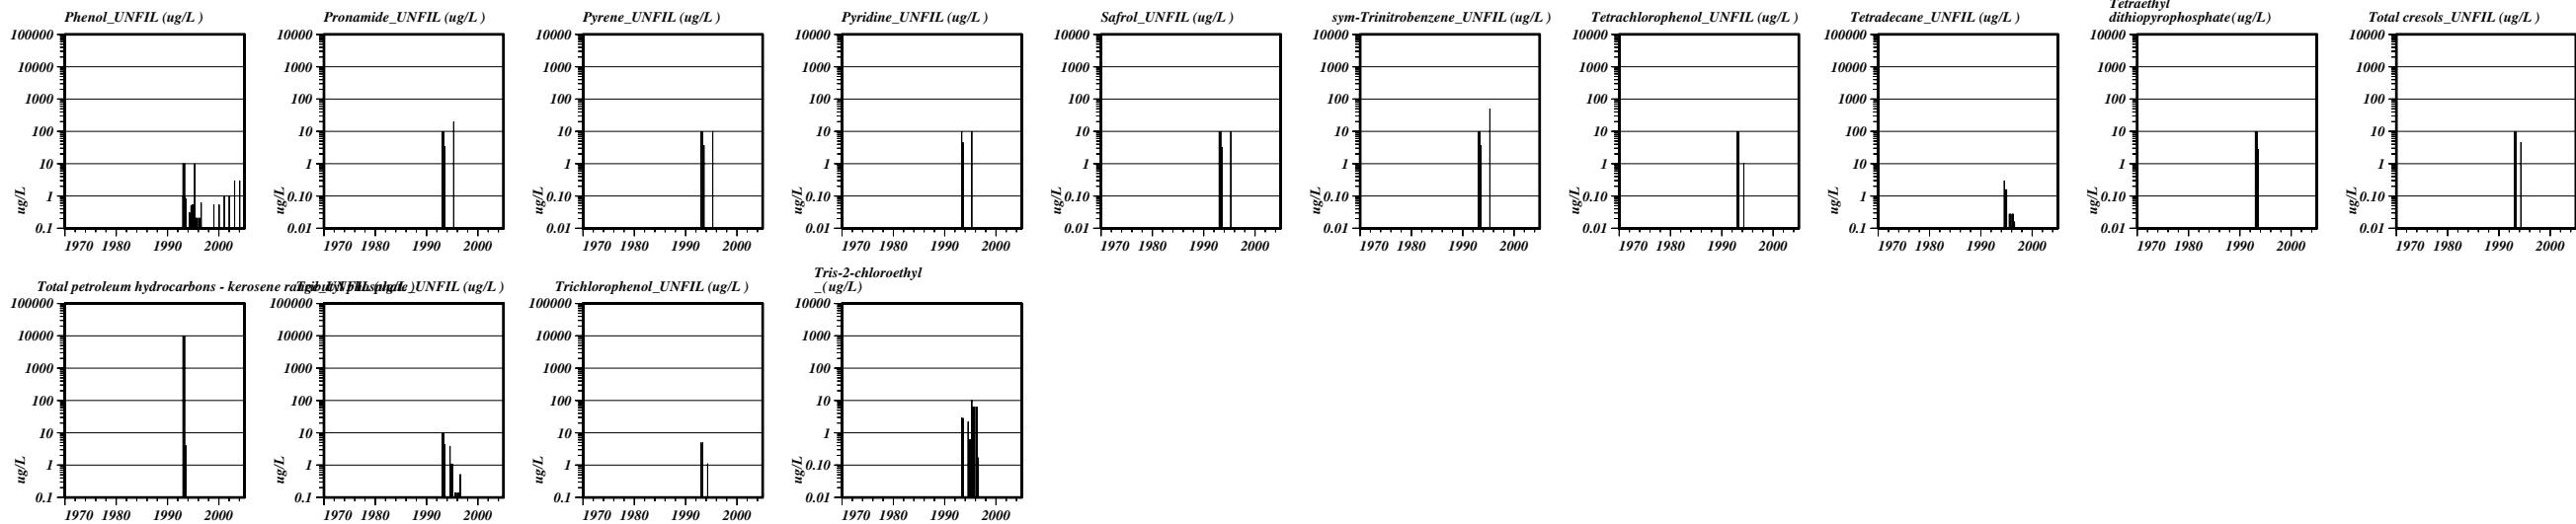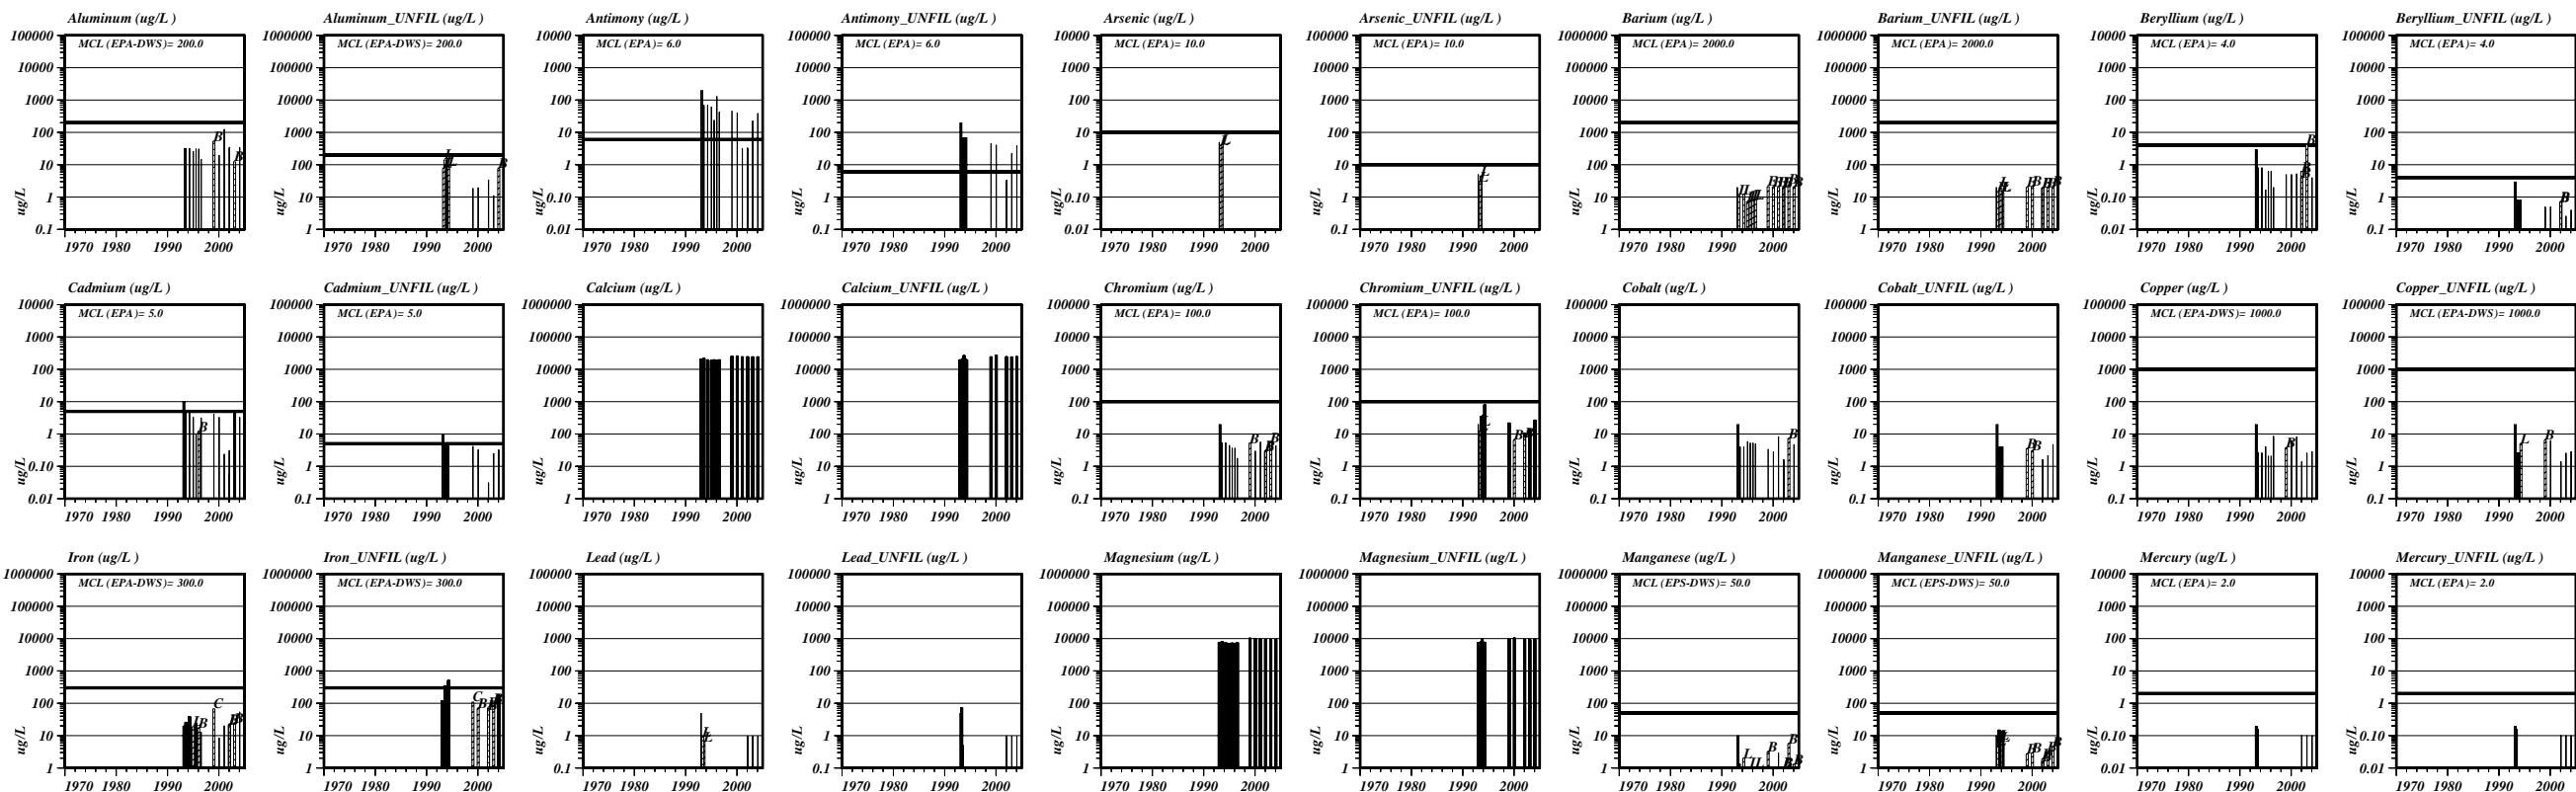**SEMI-VOLATILE ORGANIC COMPOUNDS****METALS & PHYSICAL PARAMETERS**


LABORATORY QUALIFIER FLAGS in HEIS are \*; >; B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

## METALS &amp; PHYSICAL PARAMETERS

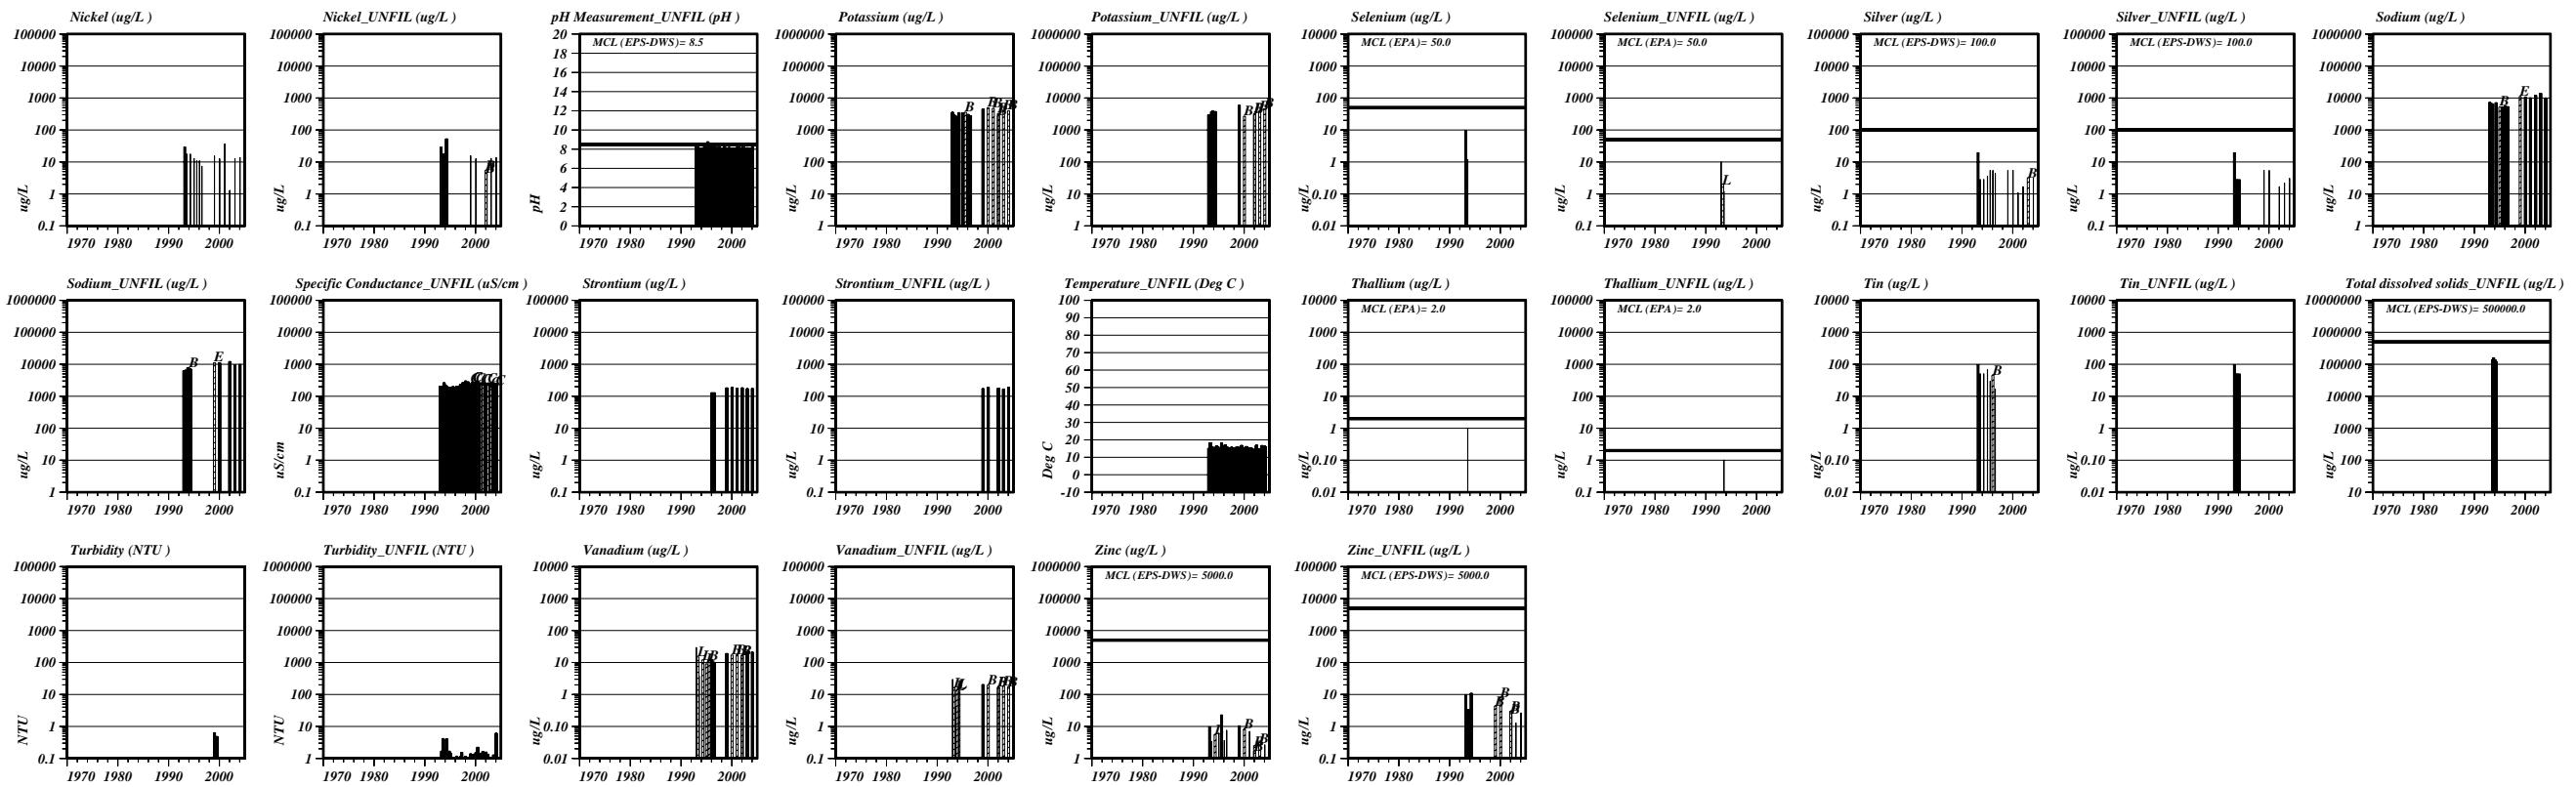


## PEST/PCB, HERB, &amp; DIOXINS

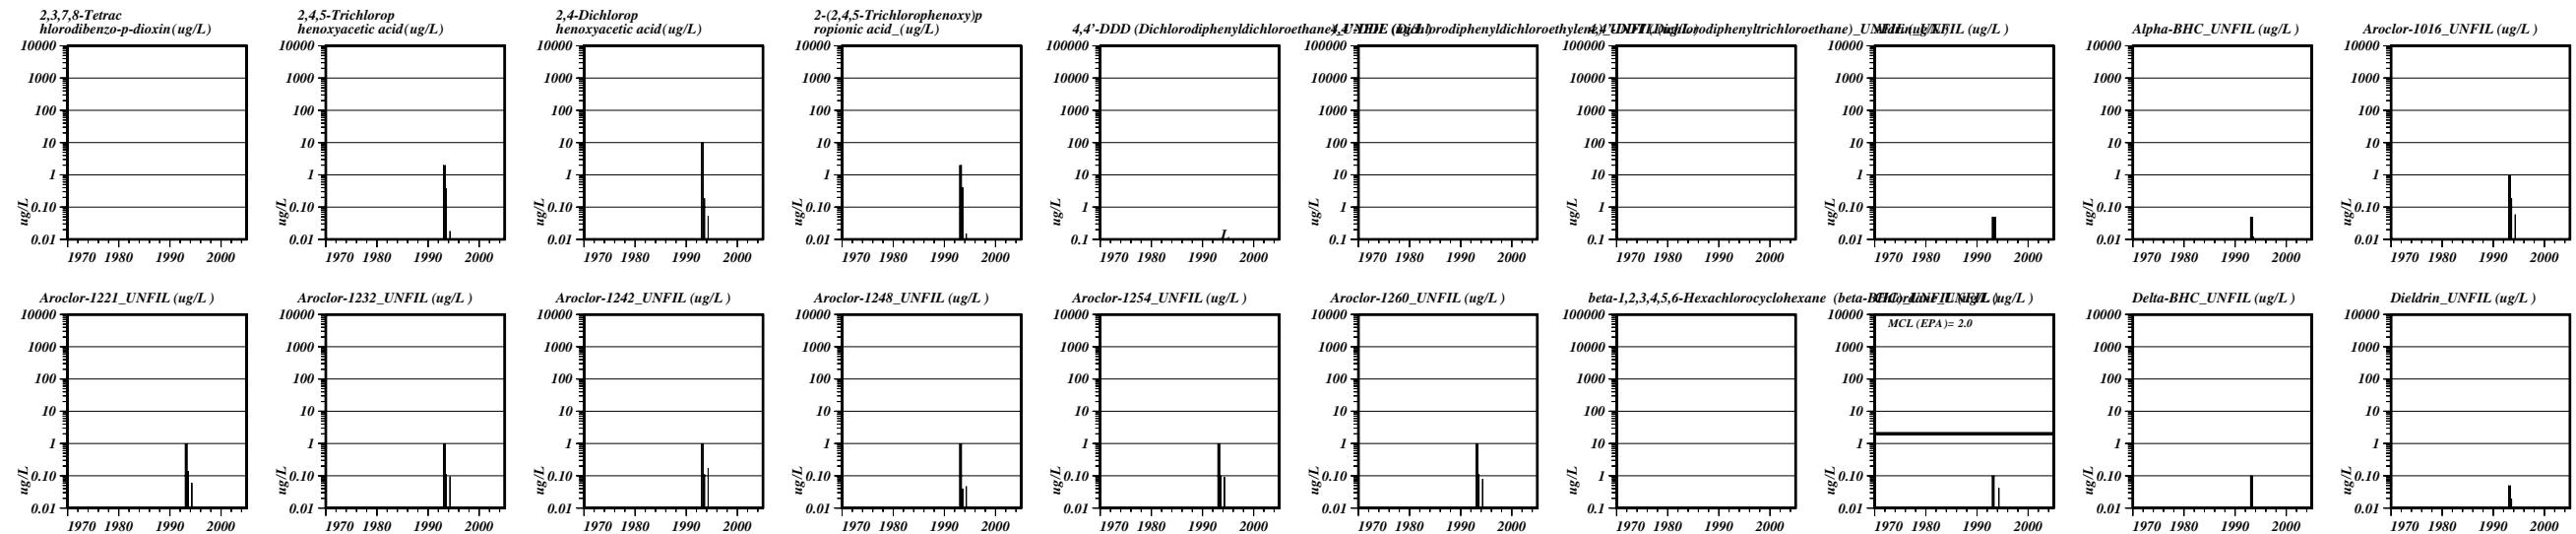


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag

## PEST/PCB, HERB, &amp; DIOXINS

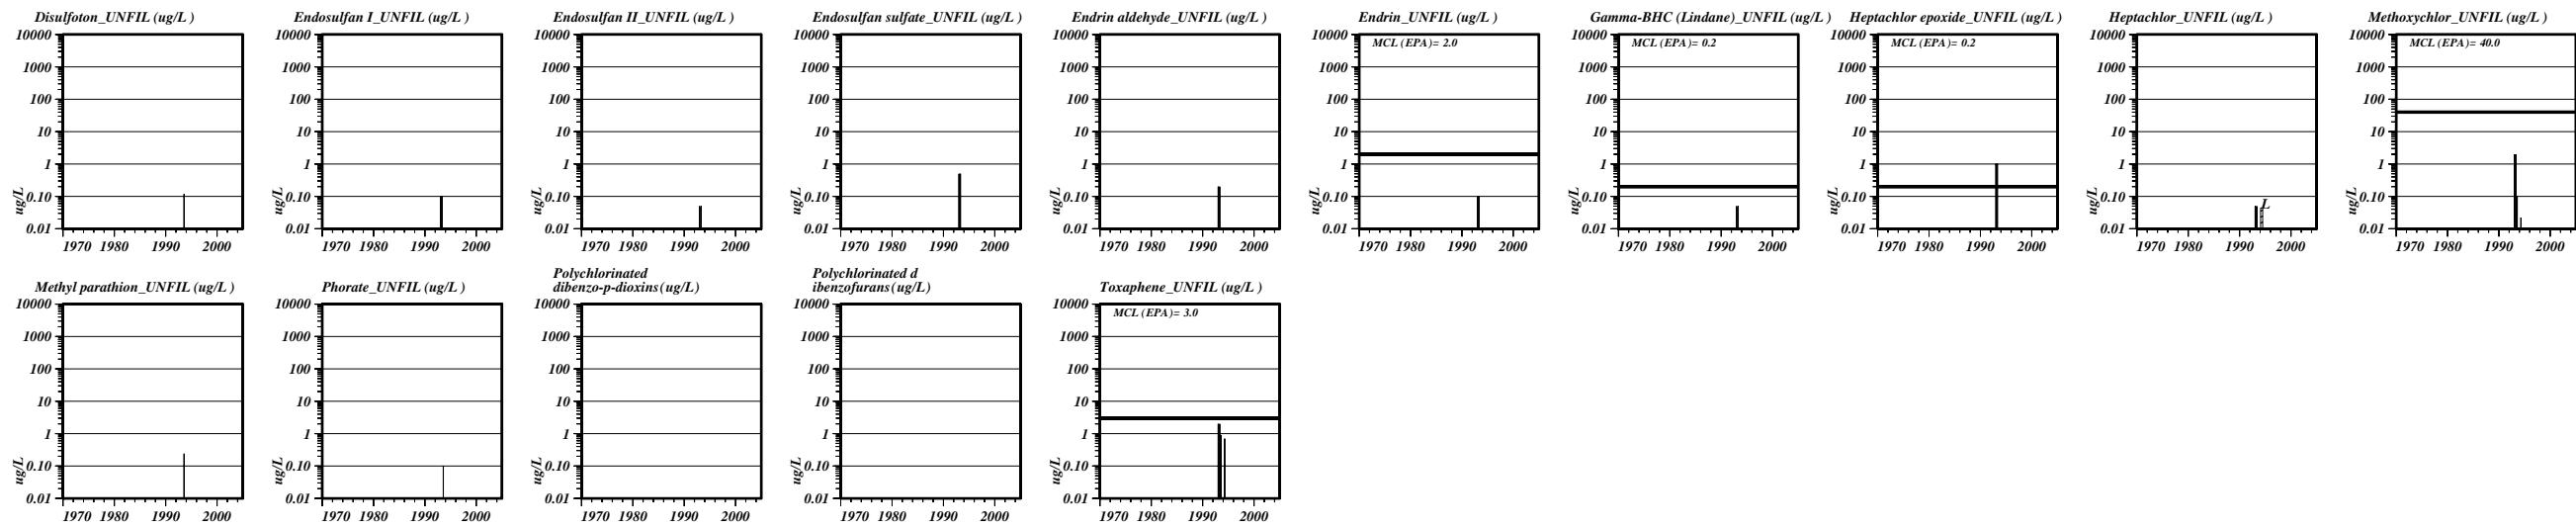

## GENCHEM &amp; ORGANICS &amp; GENORGANICS

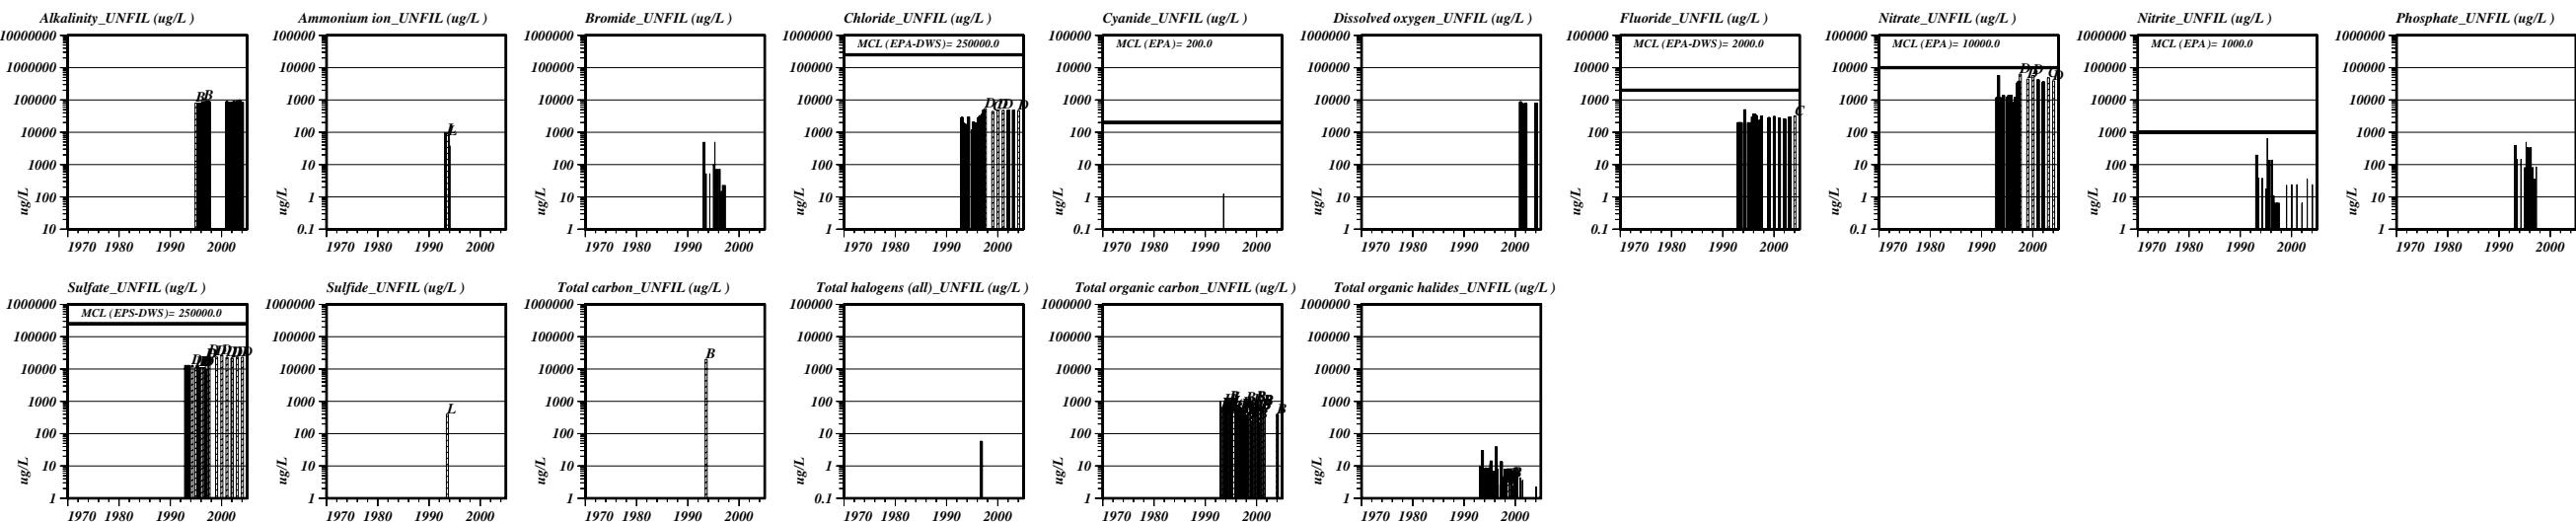

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag